


**Table 6**  
**Pump & Treat Effluent Limited Chemicals in µg/L**  
**January to October 2018**

Month	TCA	Qualifier	PCE	Qualifier	TCE	Qualifier
January	0.38	< RL	0.68	J	0.43	J
February	0.38	< RL	0.70	J	0.73	
March	0.38	< RL	0.69	J	0.79	
April	0.38	< RL	0.68	J	0.73	
May	0.93		1.20		1.40	
June	2.9		0.78	J	6.0	
July	0.38	< RL	1.30		1.20	
August	0.86	J	1.50		1.3	
September	2.2	J	0.95	J	5.70	
October	0.24	J	0.15	<RL	1.00	
Reporting Limit	1.0		1.0		0.50	

J=Result is < the Reporting Limit but >/= the Method Detection Limit & the concentration is an approximate value.

Avg.	0.903	0.86	1.93
------	-------	------	------

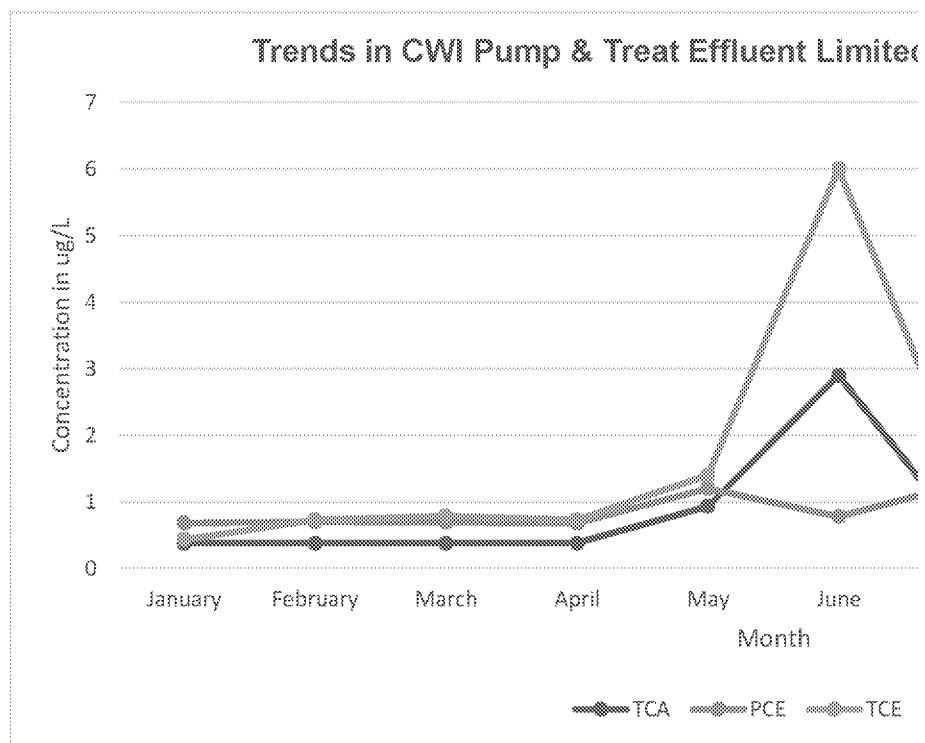

### Chemicals in 2018

